

Project:

Order No: Premio EPS100 Compression test

Part No: P100/2018_08_29(1)


Customer: Premio Hungária

Tester: Thümler GmbH-Z5

Method: MSZ EN 826

Execution date: 2018. 08. 29. 12:55:44

Chart:

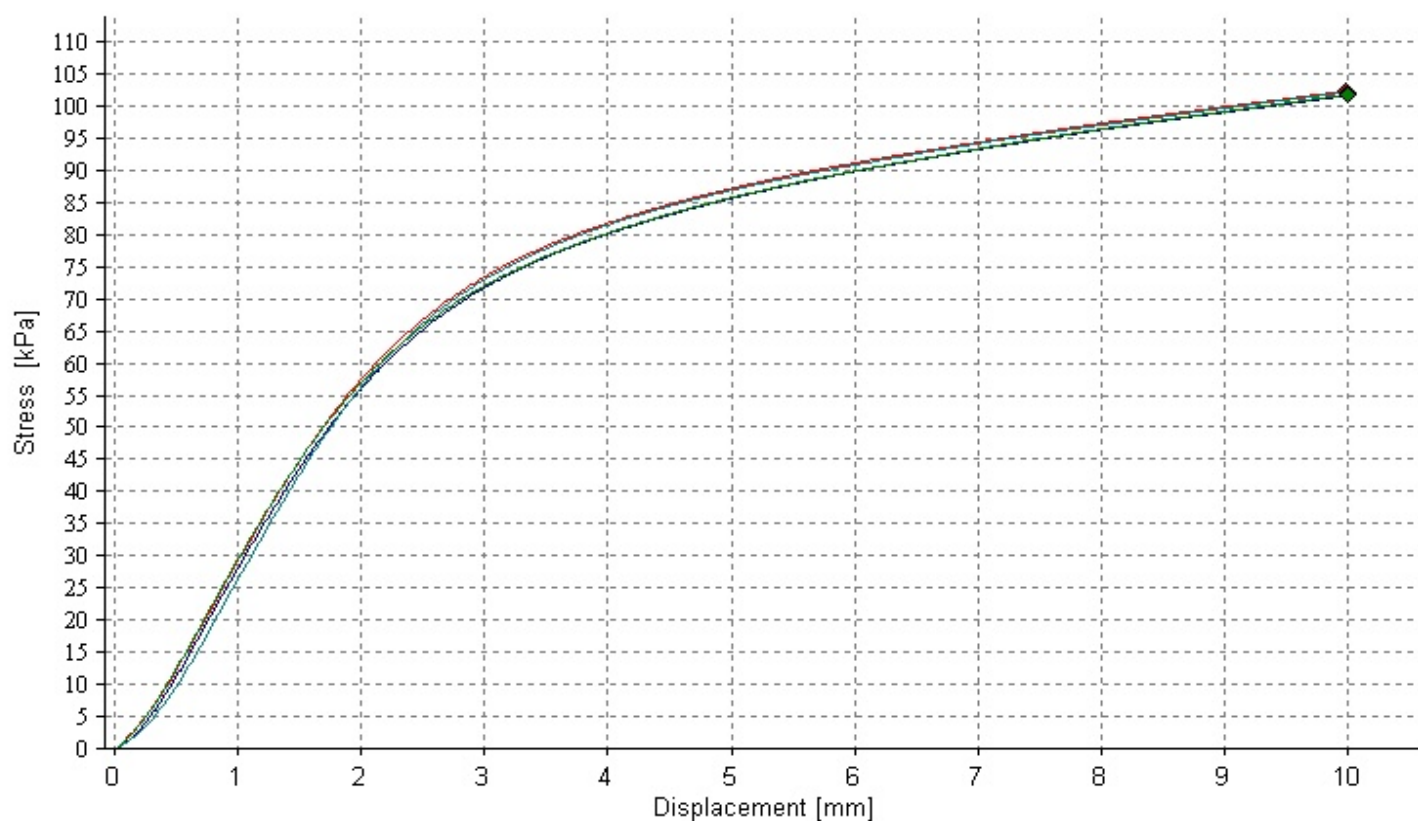

Results:

Nom	Stress [kPa] ,max.	Displacement [mm] ,max.
P100/2018_08_29(1)	102,36	9,99
P100/2018_08_29(2)	101,63	10,00
P100/2018_08_29(3)	102,17	9,99
P100/2018_08_29(5)	101,80	9,99
Max.	102,36	10,00
Min.	101,63	9,99
Mean	101,99	9,99