

Project:

Order No: Premio EPS80 Compression test

Part No: P80/2018_09_11(1)


Customer: Premio Hungária

Tester: Thümler GmbH-Z5

Method: MSZ EN 826

Execution date: 2018. 09. 11. 14:41:56

Chart:

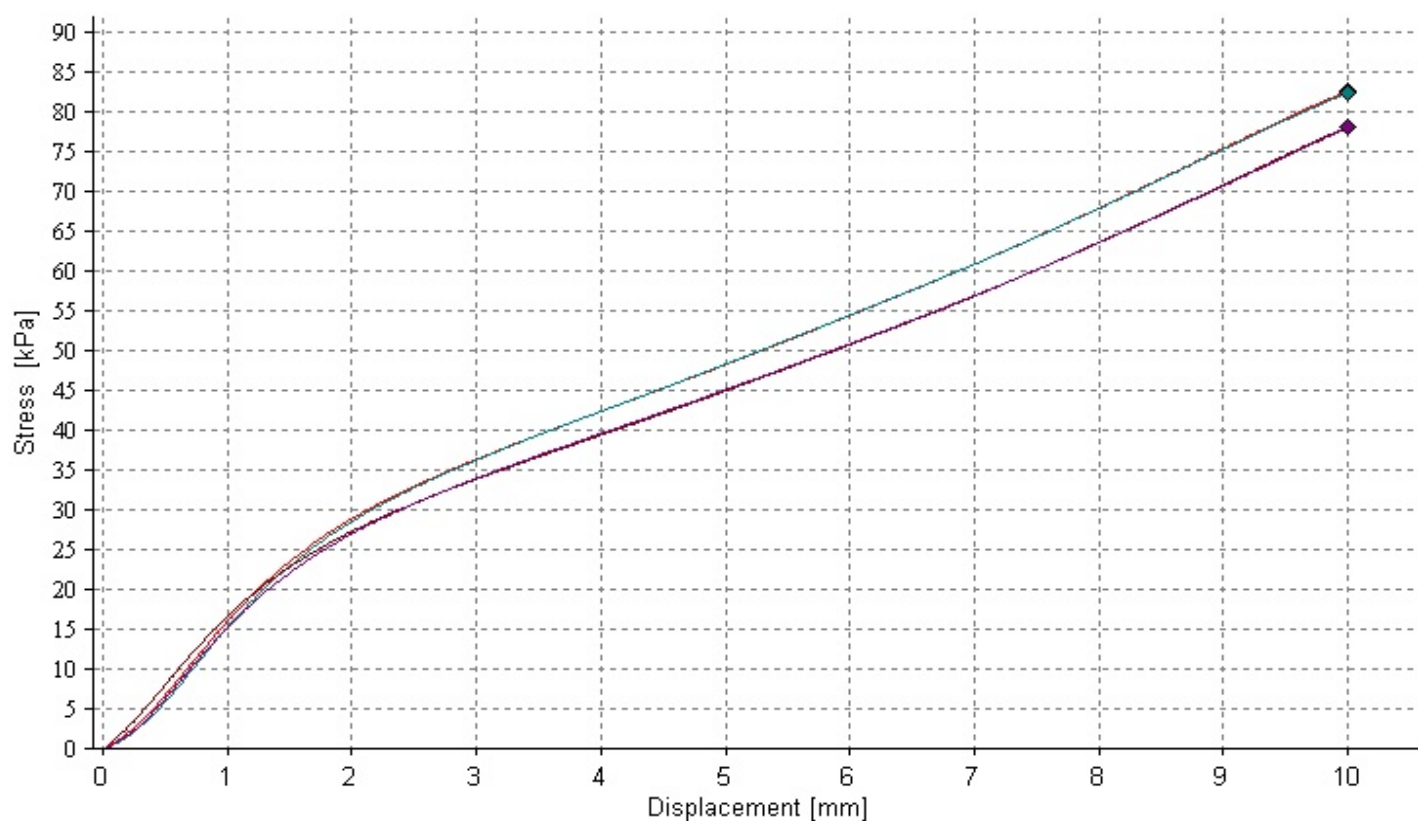

Results:

Nom	Stress [kPa] ,max.	Displacement [mm] ,max.
P80/2018_09_21 (1)	82,56	10,00
P80/2018_09_21 (3)	82,33	10,00
P80/2018_09_21 (6)	78,09	9,99
P80/2018_09_21 (7)	77,95	9,99
Max.	82,56	10,00
Min.	77,95	9,99
Mean	80,23	9,99