

Project:

Order No: Premio EPS80 Compression test

Part No: P80/2019_06_04(1)


Customer: Premio Hungária

Tester: Thümler GmbH-Z5

Method: MSZ EN 826

Execution date: 2019. 06. 04. 13:23:45

Chart:

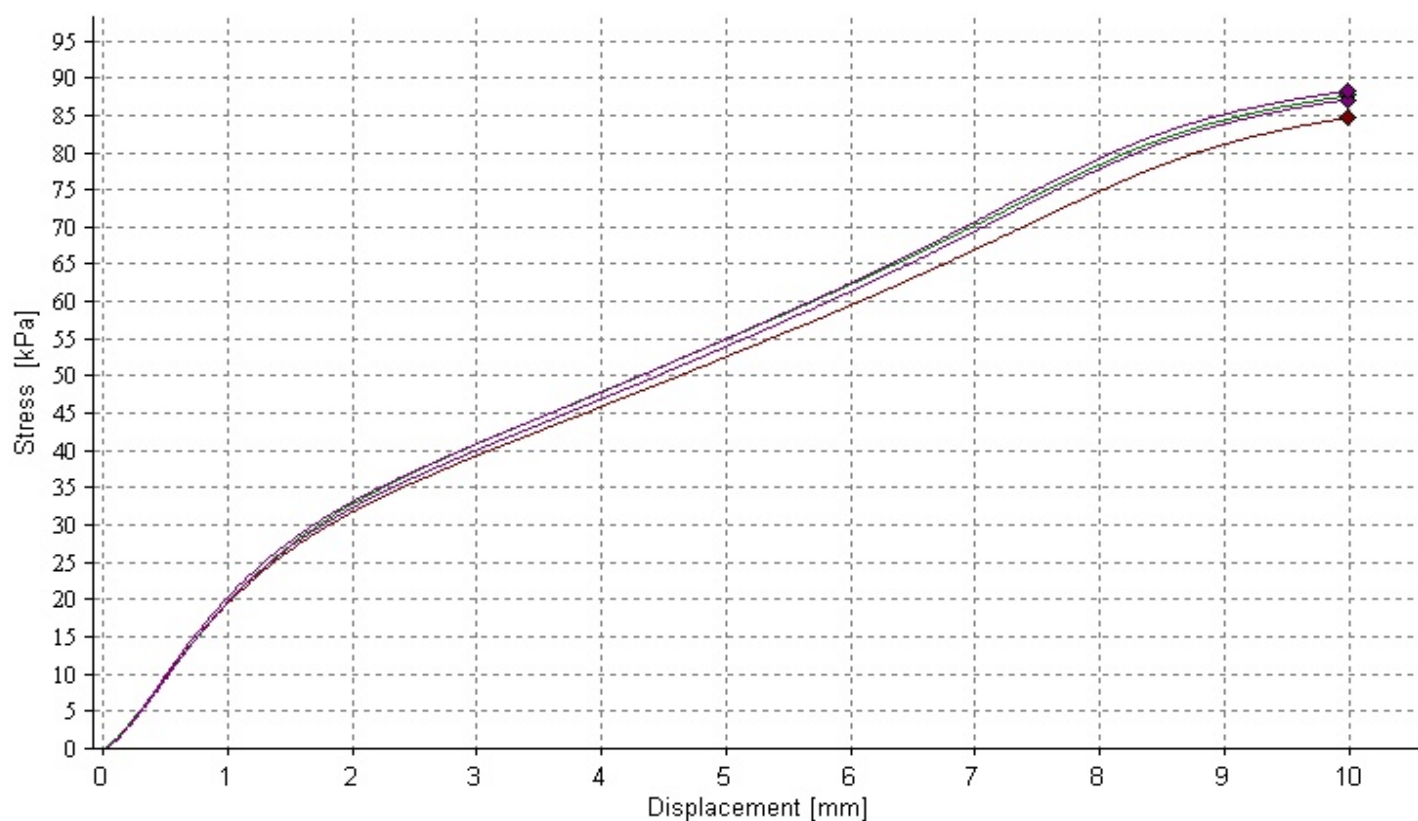

Results:

Nom	Stress [kPa] ,max.	Displacement [mm] ,max.
P80/2019_06_04 (5)	87,63	9,99
P80/2019_06_04 (6)	84,65	9,99
P80/2019_06_04 (7)	87,09	9,99
P80/2019_06_04 (8)	88,27	9,99
Max.	88,27	9,99
Min.	84,65	9,99
Mean	86,91	9,99