

Project:

Order No: Premio EPS80 Compression test

Part No: P80/2020_11_20


Customer: Premio Hungária

Tester: Thümler GmbH-Z5

Method: MSZ EN 826

Execution date: 2020. 11. 20. 12:59:02

Chart:

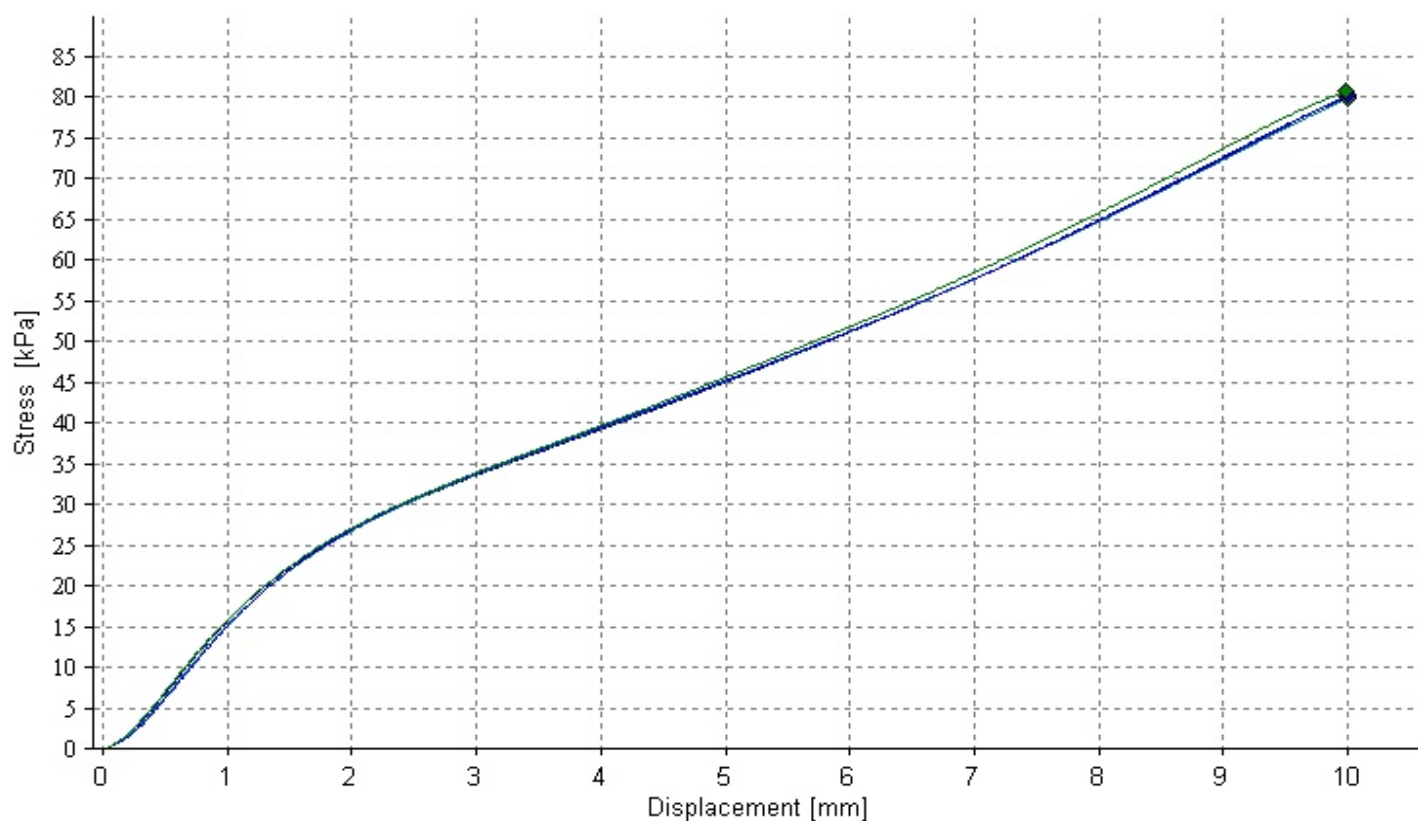

Results:

Nom	Stress [kPa] ,max.	Displacement [mm] ,max.
P80/2020_11_20 (2)	80,05	9,99
P80/2020_11_20 (3)	79,78	9,99
P80/2020_11_20 (4)	80,19	10,00
P80/2020_11_20 (5)	80,78	9,99
Max.	80,78	10,00
Min.	79,78	9,99
Mean	80,20	9,99